

- NOTES:
1. ALL DIMENSIONS SHOWN IN TABLE ARE IN INCHES, UNLESS OTHERWISE NOTED & ARE ± 1 INCH (25MM).
  2. ALL ITEMS SHOWN IN PHANTOM LINE ARE TO BE PROVIDED BY OTHERS.
  3. ALL DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT ANY NOTICE.
  4. INSTALL UNIONS FITTINGS ON INLET & OUTLET PLUMBING CONNECTIONS.
  5. PROVIDE A 2 FEET MINIMUM CLEARANCE ABOVE MINERAL TANK FOR FILLING MEDIA.
  6. FOR INSTALLATIONS USING METAL PLUMBING, CONNECT A METAL BONDING STRAP TO INLET & OUTLET METAL PLUMBING TO MAINTAIN ELECTRICAL CONTINUITY.
  7. PROVIDED SYSTEM SHALL NOT BE SUBJECT TO ANY VACUUM. IF RISK OF VACUUM IS PRESENT, INSTALL VACUUM RELIEF VALVE WATTS ORDERING CODE # 0556031 ON OUTLET LINE.
  8. THE FULL WEIGHT OF THE PIPING AND VALVES MUST BE SUPPORTED BY PIPE HANGERS OR OTHER MEANS.
  9. INLET AND OUTLET HEADERS NEED TO BE SIZED ACCORDING TO FLOW RATE REQUIREMENTS BY OTHERS.
  10. LIMIT INLET PRESSURE TO NOT EXCEED MAXIMUM PUBLISHED OPERATING PRESSURE.
  11. PLUMBING ADAPTORS CAN ROTATE TO ACCOMMODATE OPTIMAL PIPING CONFIGURATIONS.

SERIES OFRES DIMENSION (INCHES) & SPECIFICATIONS														
MODEL NO.	ORDERING CODE (EDP NO.)	MINERAL TANK SIZE	INLET	OUTLET	OVERALL HEIGHT (SEE NOTE 5)	OVERALL DEPTH	OVERALL WIDTH	MINIMUM INLET PIPE DISTANCE	SYSTEM INLET/OUTLET PIPE SIZE CONN. (NPT)	PEAK SERVICE FLOW GPM	MIN/MAX OPERATING TEMP F°	MIN/MAX OPERATING PRESSURE (PSI)	ESTIMATED OPERATING WEIGHT (LBS)	ESTIMATED SHIPPING WEIGHT (LBS)
OFRES-0835	7100487	8 X 35	37.25	37.25	40.00	12.00	8.00	3.10	1.0	8	40/100	15/100	84.00	19.00
OFRES-0935	7100488	9 X 35	37.25	37.25	40.00	12.50	9.00	3.60	1.0	12	40/100	15/100	106.00	23.00
OFRES-1035	7100489	10 X 35	37.25	37.25	40.00	13.00	10.00	4.10	1.0	16	40/100	15/100	126.00	25.00

**WATTS**  
 815 CHESTNUT ST.  
 NORTH ANDOVER, MA 01845

THIS DRAWING DISCLOSES CONFIDENTIAL AND OTHER DATA OF A PROPRIETARY NATURE OWNED BY WATTS WATER TECHNOLOGIES, INC. AND MAY NOT BE USED OR DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF WATTS WATER TECHNOLOGIES, INC.

DWG BY: JR  
 DATE: 5/21/2021  
 CHD BY: RL

SCALE: NTS  
 SHEET: 1 OF 1

SUPERSEDES: SEE TABLE

LIMITS UNLESS SPECIFIED

FRACTIONAL	ANGULAR
±1/32"	±1°
±0.0015"	±0.005°
±0.0025"	±0.01°
±0.005"	±0.02°
±0.01"	±0.04°
±0.02"	±0.08°
±0.05"	±0.16°
±0.1"	±0.32°
±0.2"	±0.64°
±0.5"	±1.6°
±1"	±3.2°
±2"	±6.4°
±5"	±16°
±10"	±32°

DO NOT SCALE DRAWING

TITLE: GENERAL INSTALLATION, SERIES OFRES 1" ONEFLOW SYSTEMS

PART NO.: SEE TABLE

MATERIAL: N/A





OTHER: ESTIMATED WEIGHT: SEE TABLE

EDP NO.: SEE TABLE

FILE TYPE: CAD

SIZE: D

REV: 1

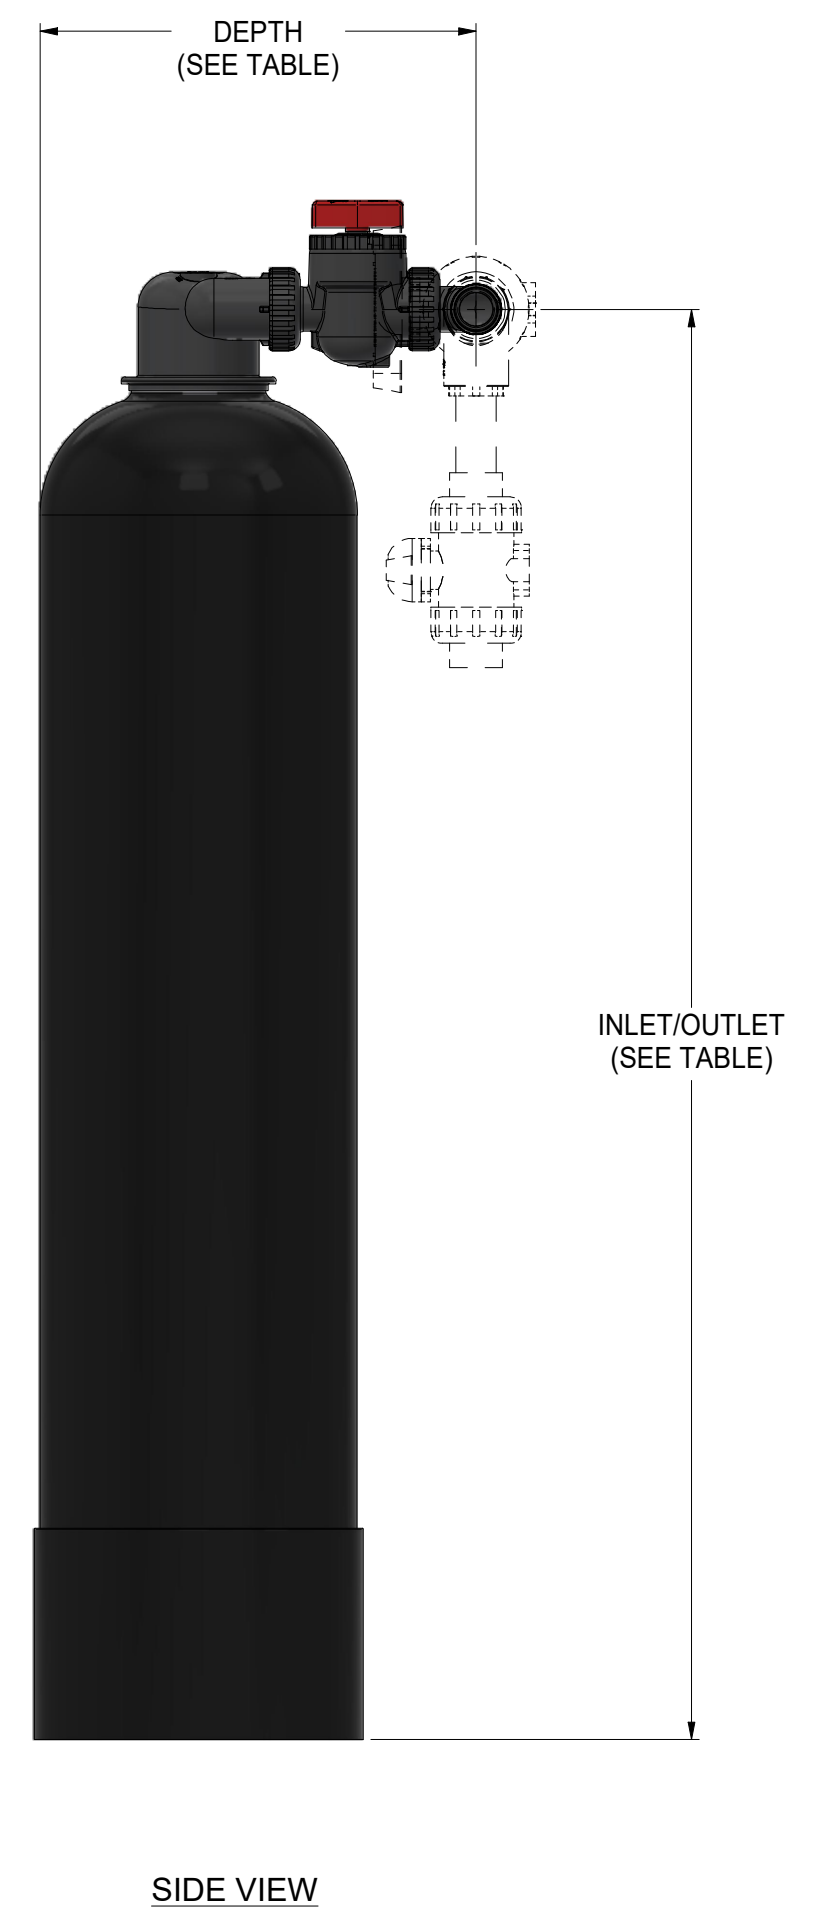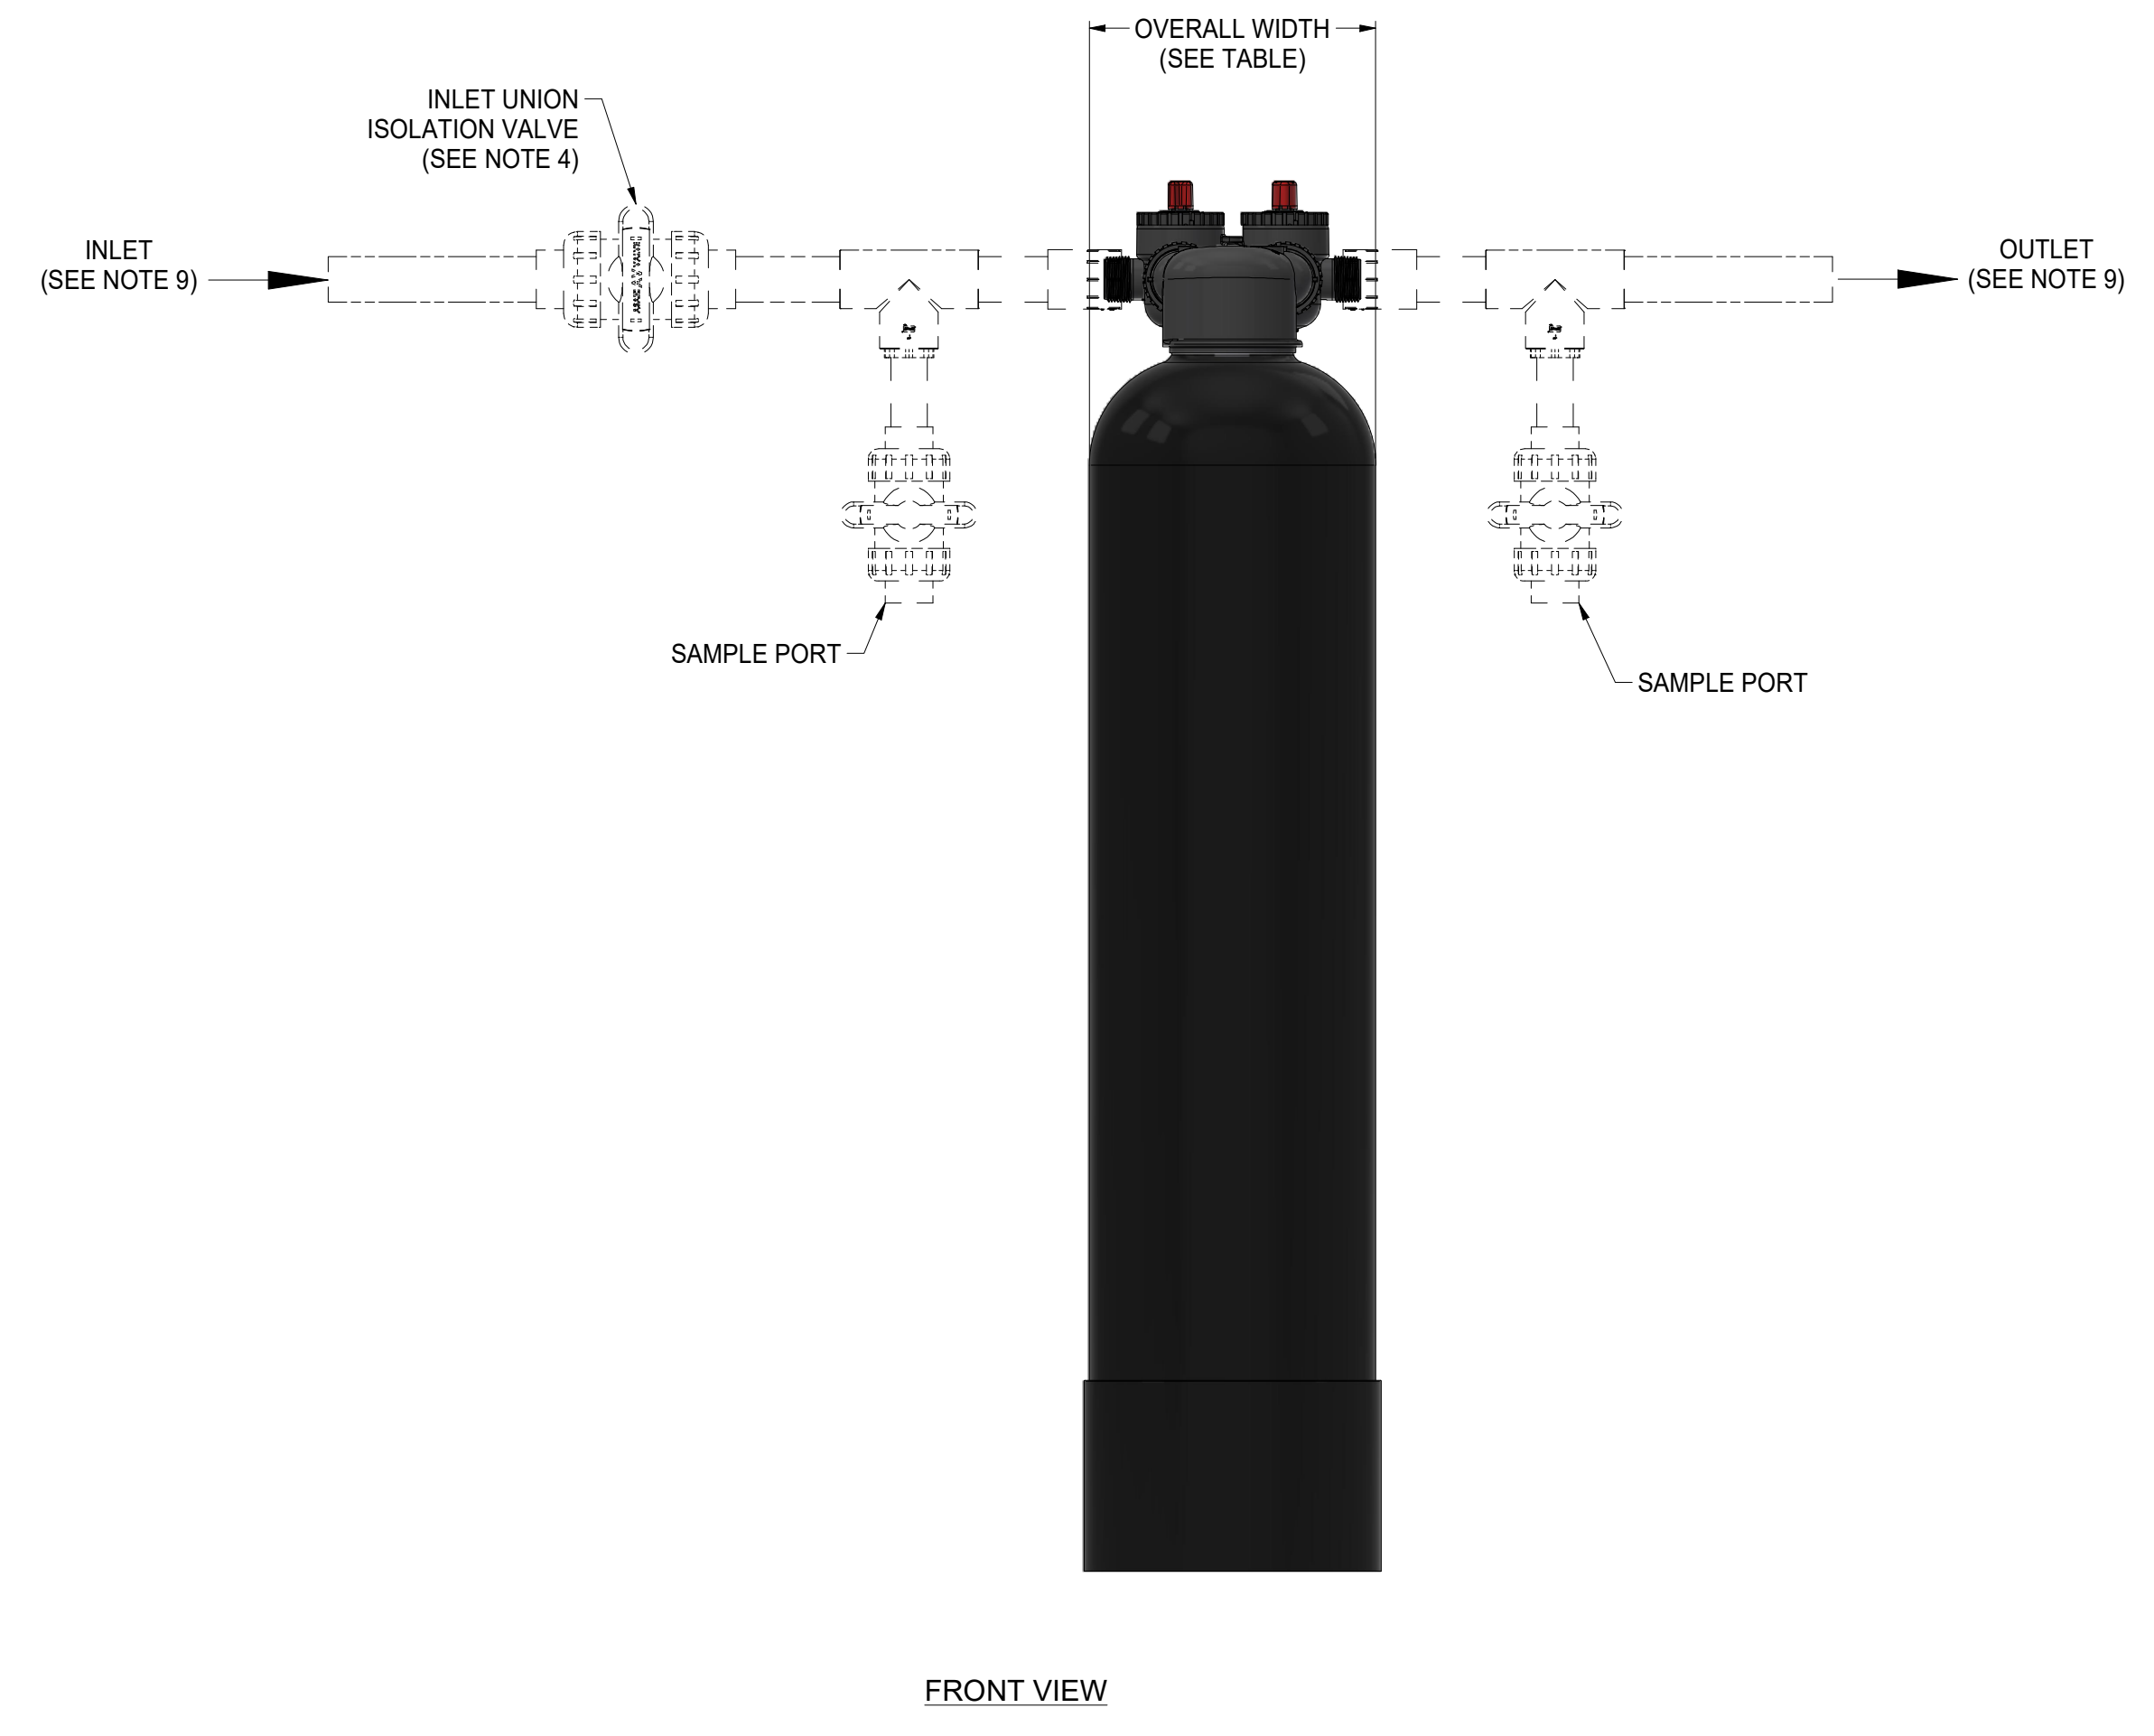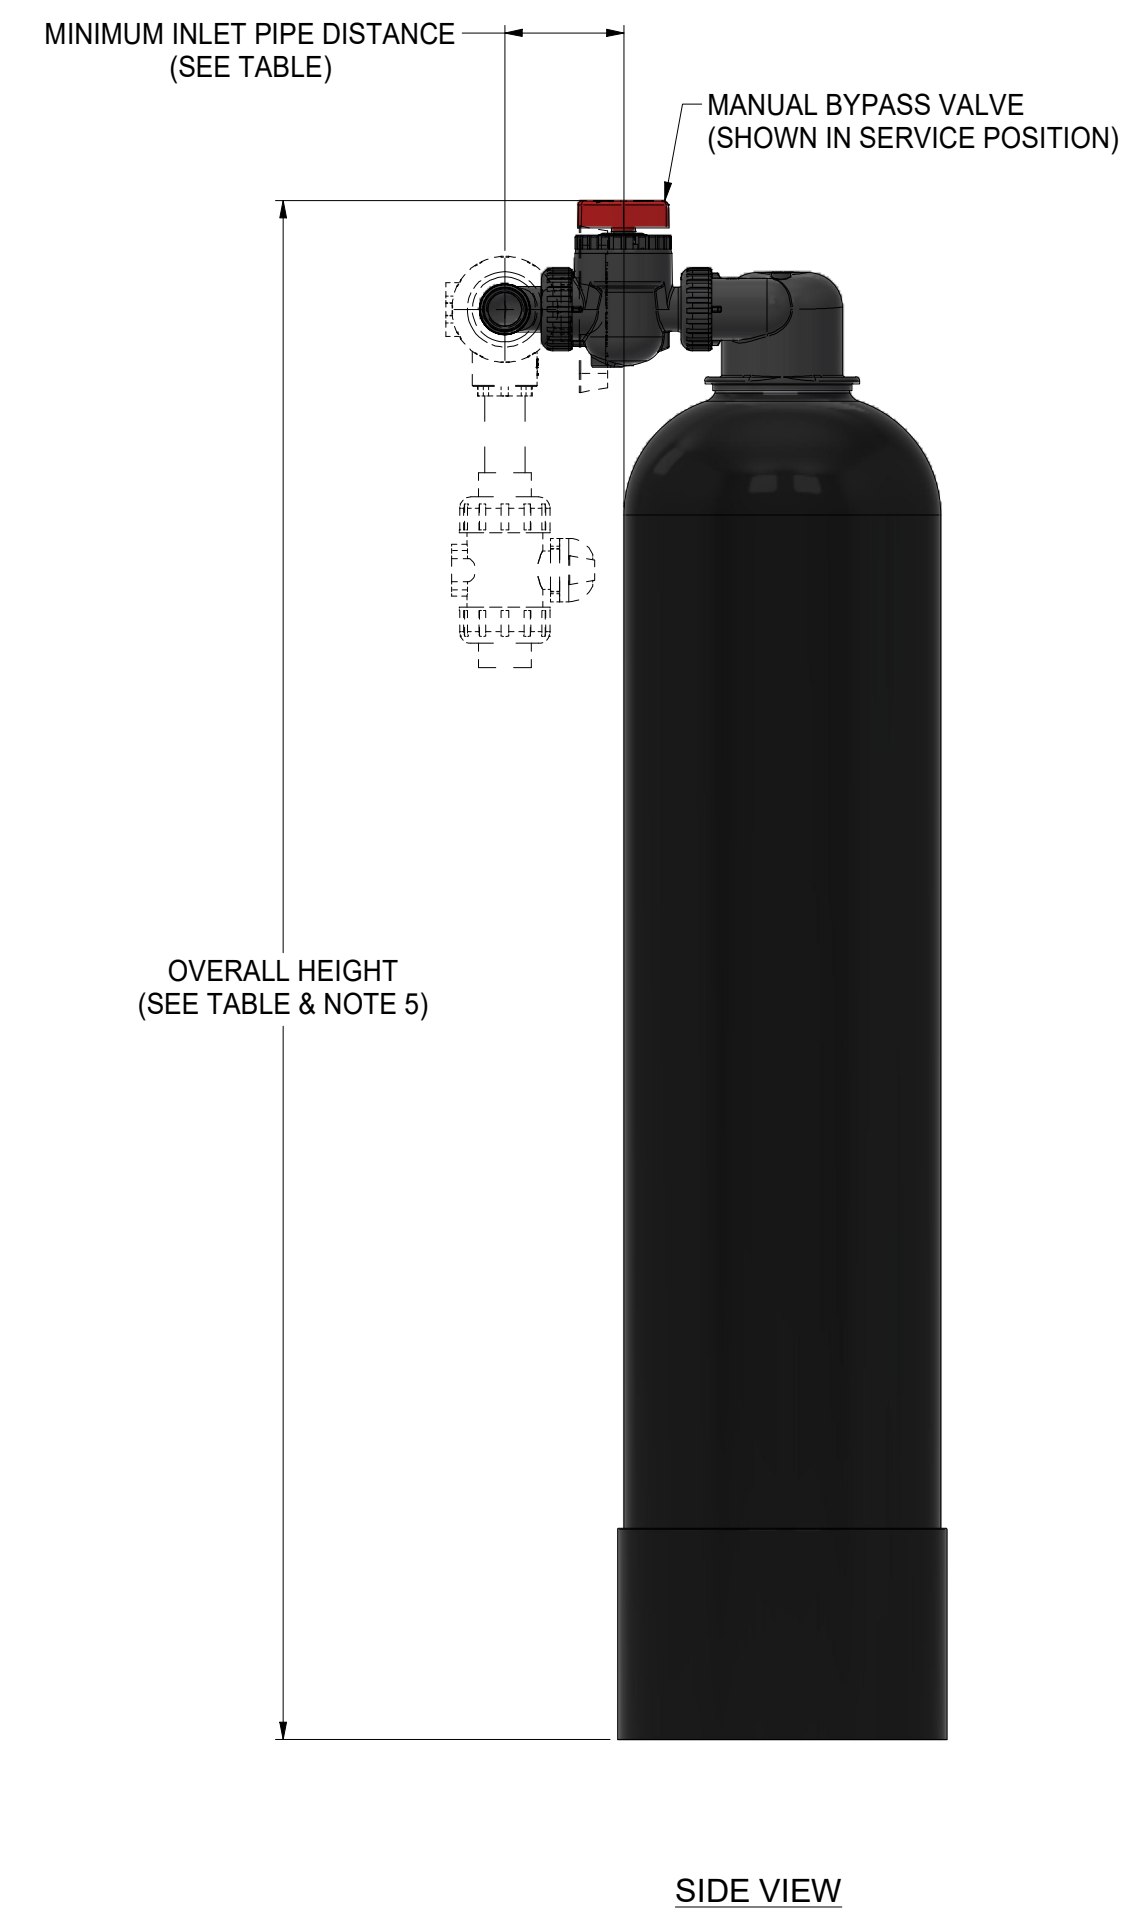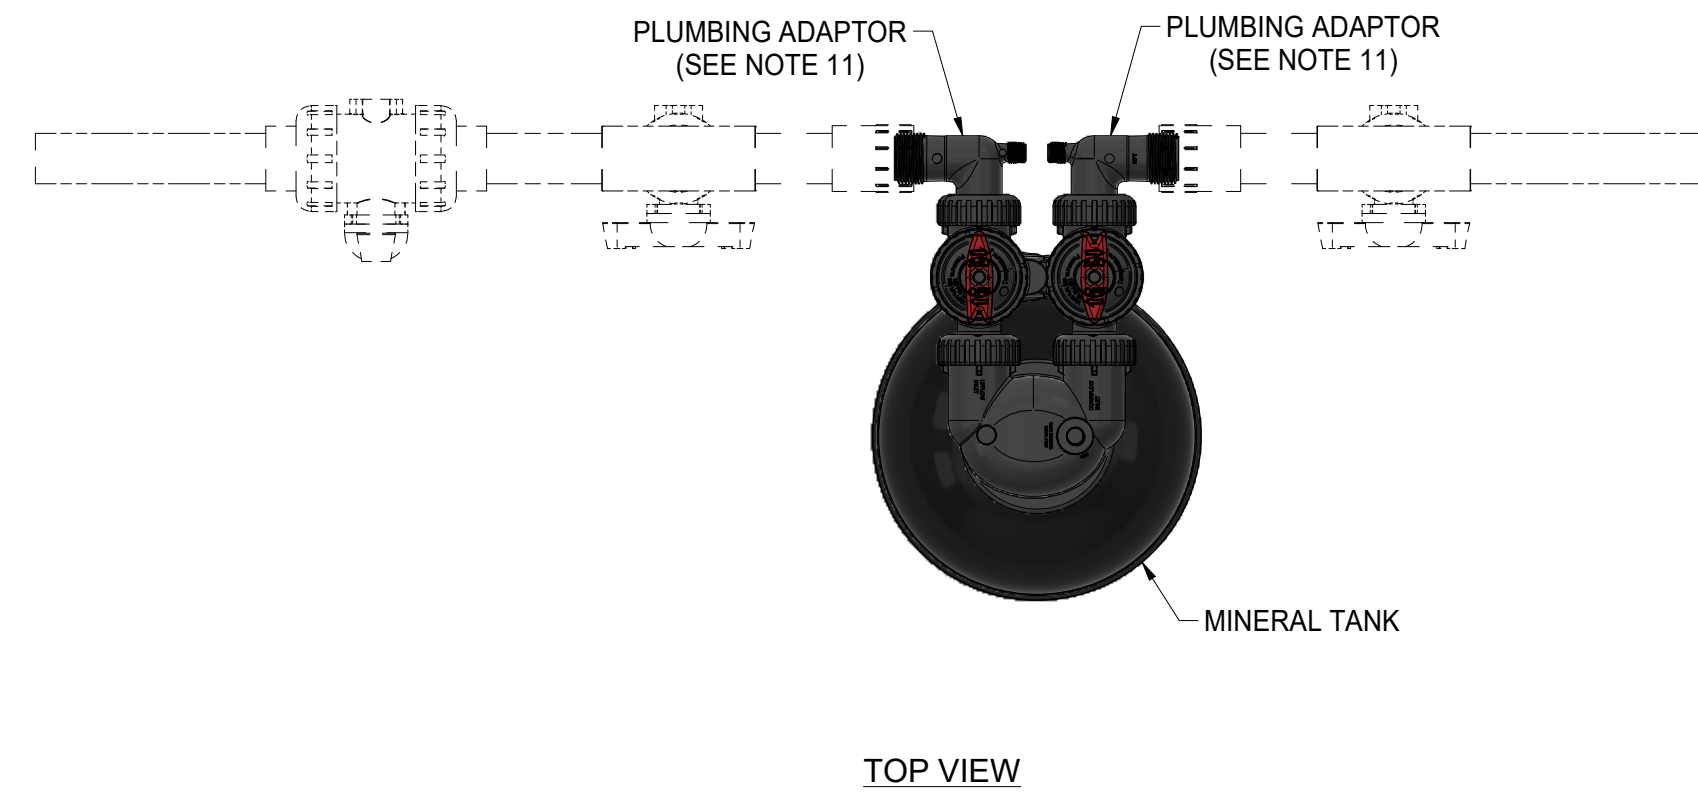

CLIENT PROJECT SIGN-OFF	
JOB NAME:	
JOB LOCATION:	
CONTRACTOR:	
CONTRACTOR APPROVAL:	
CONTRACTOR APPROVAL DATE:	
CONTRACTOR PO NO:	
ENGINEER:	
ENGINEER APPROVAL:	
ENGINEER APPROVAL DATE:	