

- NOTES:
- ALL DIMENSIONS SHOWN IN TABLE ARE IN INCHES, UNLESS OTHERWISE NOTED & ARE ± 1 INCH (25MM).
  - ALL ITEMS SHOWN IN PHANTOM LINE ARE TO BE PROVIDED BY OTHERS.
  - ALL DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT ANY NOTICE.
  - INSTALL UNIONS FITTINGS ON INLET, OUTLET & DRAIN PLUMBING CONNECTIONS.
  - PROVIDE A 2 FEET MINIMUM CLEARANCE ABOVE MINERAL TANK FOR FILLING MEDIA.
  - A GFCI EQUIPT ELECTRICAL OUTLET SHOULD BE PROVIDED WITHIN 5 FEET OF EQUIPMENT LOCATION.
  - USE DIELECTRIC UNIONS ON PLUMBING CONNECTIONS OF CONTROL VALVE WHEN DISSIMILAR METALS ARE PRESENT.
  - PROVIDED SYSTEM SHALL NOT BE SUBJECT TO ANY VACUUM. IF RISK OF VACUUM IS PRESENT, INSTALL SIPHON BREAK ON DRAIN LINE & INSTALL VACUUM RELIEF VALVE WATTS ORDERING CODE # 0556031 ON INLET LINE.
  - BRINE TANK DIMENSIONS SHOWN ON TABLE ARE FACTORY SELECTED FOR USE WITH THE SPECIFIED SYSTEM SIZE.
  - DO NOT INSTALL DRAIN LINE DIRECTLY TO A DRAIN. FOR PROPER DRAIN CONNECTION FOLLOW ALL NATIONAL, STATE AND LOCAL CODES. DO NOT CONSTRUCT DRAIN LINE TO ELEVATIONS THAT EXCEED 4 FEET ABOVE THE CONTROL VALVE'S DRAIN PORT.
  - THE FULL WEIGHT OF THE PIPING AND VALVES MUST BE SUPPORTED BY PIPE HANGERS OR OTHER MEANS.
  - INLET AND OUTLET HEADERS NEED TO BE SIZED ACCORDING TO FLOW RATE REQUIREMENTS BY OTHERS.
  - POWER REQUIREMENTS: 115V/60HZ 2.7 AMPS PER CONTROL VALVE UNLESS OTHERWISE SPECIFIED.
  - BRINE TANK MUST BE LOCATED WITHIN 10 FEET OF SYSTEM CONTROL VALVE AND ON A COMMON FLOOR ELEVATION WITH MINERAL TANK TO ENSURE PROPER BRINE DRAW OPERATION.
  - USE A MINIMUM OF 1 INCH SCH. 40 PVC PIPING FOR CONSTRUCTION OF BRINE LINE
  - LIMIT INLET PRESSURE TO NOT EXCEED MAXIMUM PUBLISHED OPERATING PRESSURE.

SERIES CWS-300H TRIPLEX PROGRESSIVE SYSTEMS DIMENSION (INCHES) & SPECIFICATIONS																		
MODEL NO.	ORDERING CODES (EDP NO.)	MINERAL TANK SIZE	INLET	OUTLET	OVERALL HEIGHT (SEE NOTE 5)	OVERALL DEPTH	OVERALL WIDTH	MINIMUM INLET PIPE DISTANCE	BRINE TANK (SEE NOTE 9)	CONTROL VALVE INLET/OUTLET PIPE SIZE (NPT)	DRAIN CONN. SIZE (NPT)	SERVICE FLOW GPM @ 15 PSI DROP	PEAK SERVICE FLOW GPM @ 25 PSI DROP	DRAIN FLOW RATE (GPM)	MIN/MAX OPERATING TEMP F°	MIN/MAX OPERATING PRESSURE (PSI)	ESTIMATED OPERATING WEIGHT (LBS)	ESTIMATED SHIPPING WEIGHT (LBS)
M4610WTR-NH	68110811	24 X 72	80.75	80.75	84.5	24	126.4	7.0	30 X 50	3.0	1.0	360	510	15.0	34/110	25/125	10069	3210
M4612WTR-NH	68110812	30 X 72	80.75	80.75	84.5	30	132.6	9.5	39 X 48	3.0	1.5	474	424	25.0	34/110	25/125	15471	4800
M4614WTR-NH	68110813	36 X 72	80.75	80.75	84.5	36	142.6	12.0	39 X 48	3.0	1.5	555	750	35.0	34/110	25/125	19982	6045
M4616WTR-NH	68110814	42 X 72	80.75	80.75	84.5	42	145.6	14.5	42 X 60	3.0	2.0	600	804	45.0	34/110	25/125	26582	9735
M4618WTR-NH	68110815	48 X 72	80.75	80.75	84.5	48	159.6	17.0	50 X 60	3.0	2.0	639	840	60.0	34/110	25/125	36591	12885

**WATTS** 815 CHESTNUT ST. NORTH ANDOVER, MA 01845

THIS DRAWING DISCLOSES CONFIDENTIAL AND OTHER DATA OF A PROPRIETARY NATURE OWNED BY WATTS WATER TECHNOLOGIES, INC. AND MAY NOT BE USED OR DISCLOSED TO OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF WATTS WATER TECHNOLOGIES, INC.

DWG BY: JR DATE: 4/3/2023 SCALE: NTS SUPERSEDES: SEE TABLE  
 CHD BY: JR DATE: 4/3/2023 SHEET: 1 OF 1

LIMITS UNLESS SPECIFIED: 1"10" #1 FRACTIONAL ANGULAR 1"10" #1 DECIMAL (mm) 1/32" X 1/32" ± 0.00175" (35 COMMON AXES) 1/16" X 3/16" ± 0.00175" (35 COMMON AXES) SURFACE FINISH: 125 Ra (mm) 5 Ra (mm)




TITLE: GENERAL INSTALLATION, SERIES CWS-300H TRIPLEX PROGRESSIVE SYSTEMS 3" WATER SOFTENERS

PART NO.: SEE TABLE

MATERIAL: N/A

OTHER: ESTIMATED WEIGHT: SEE TABLE

EDP NO.: SEE TABLE SIZE: D REV: 1 FILE TYPE: CAD

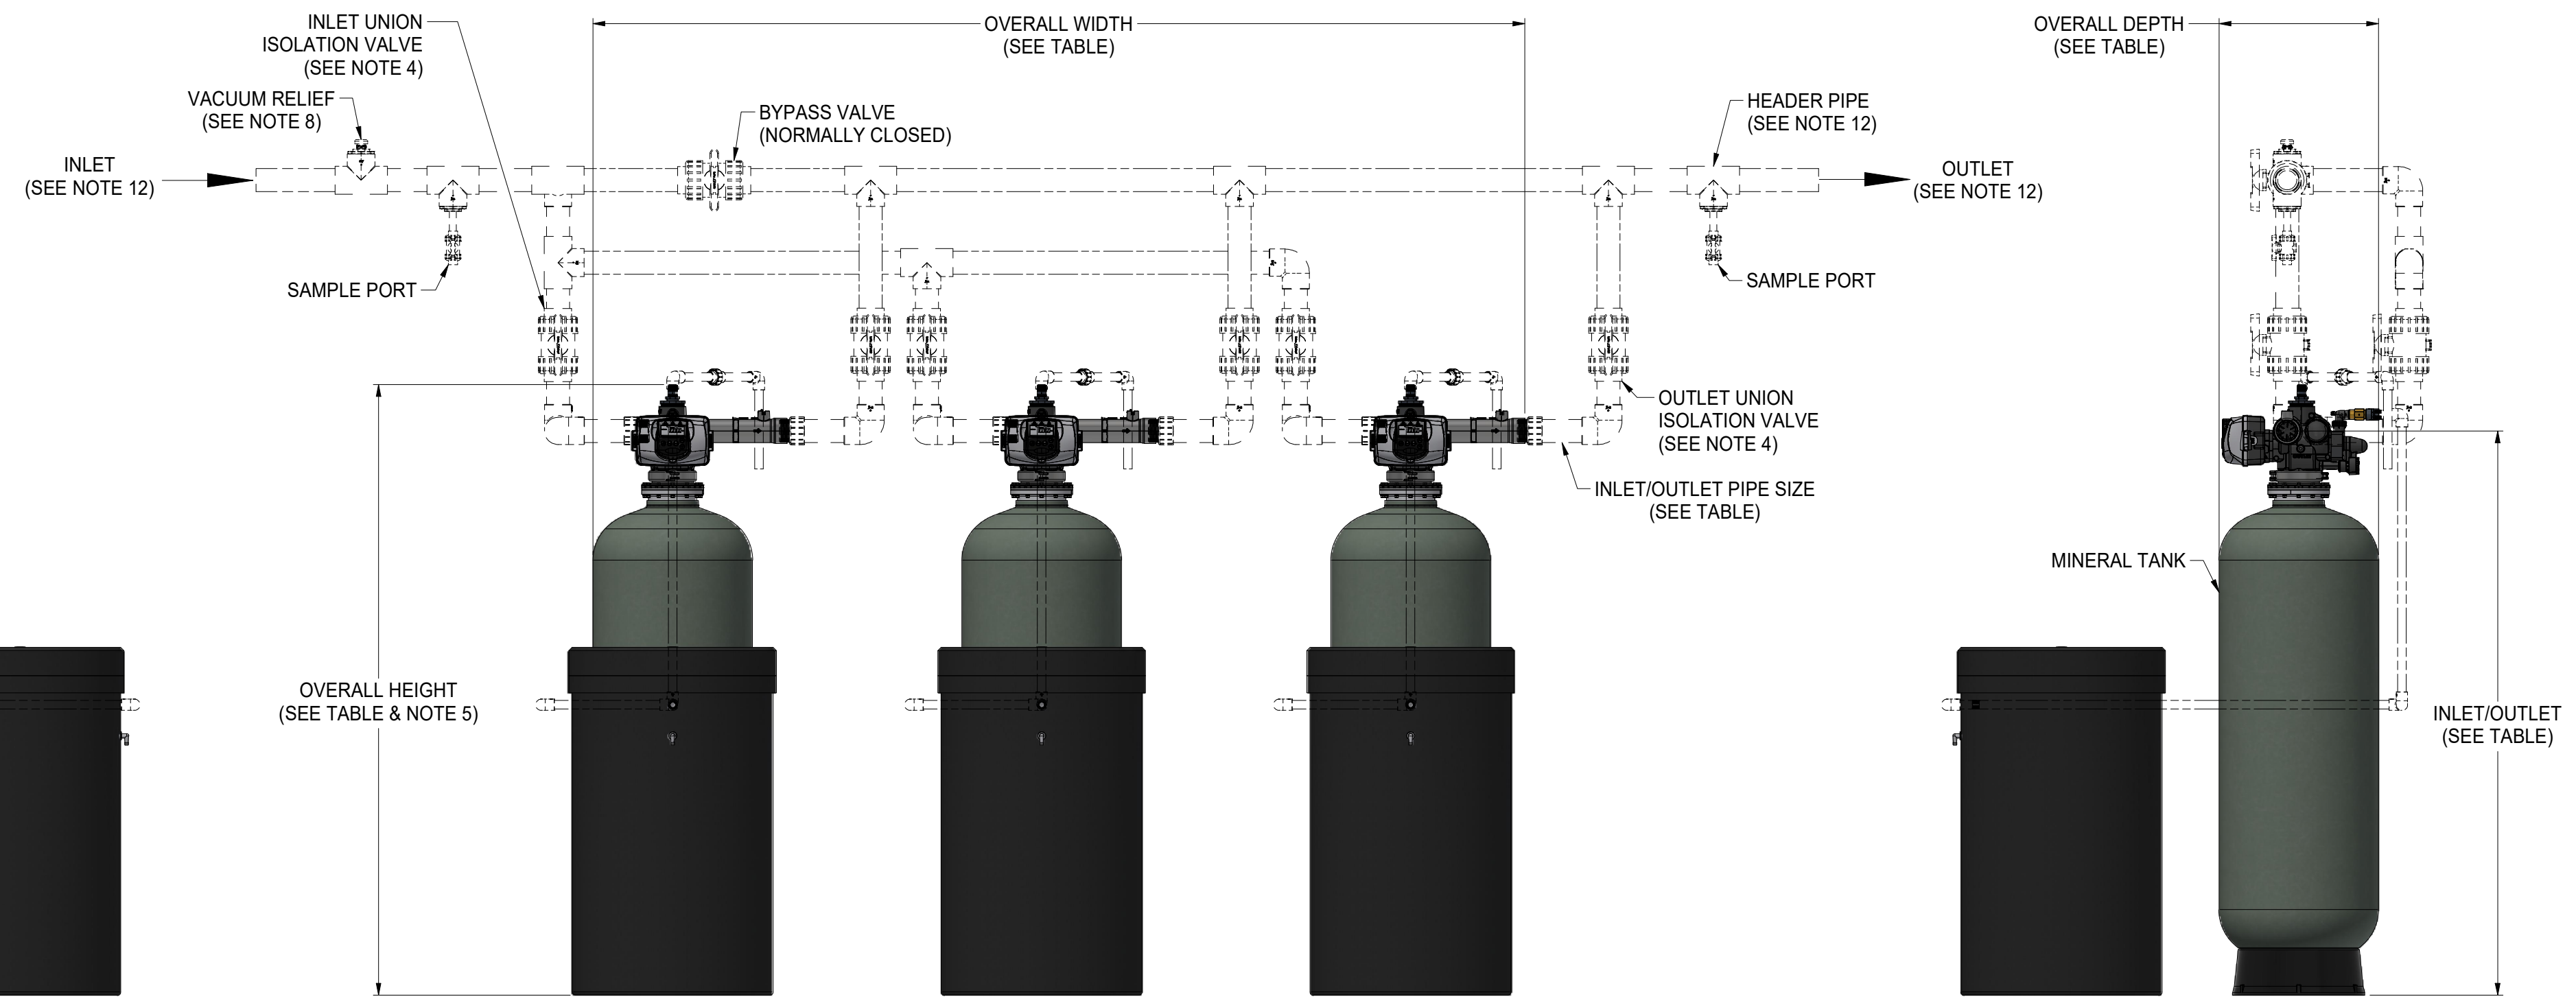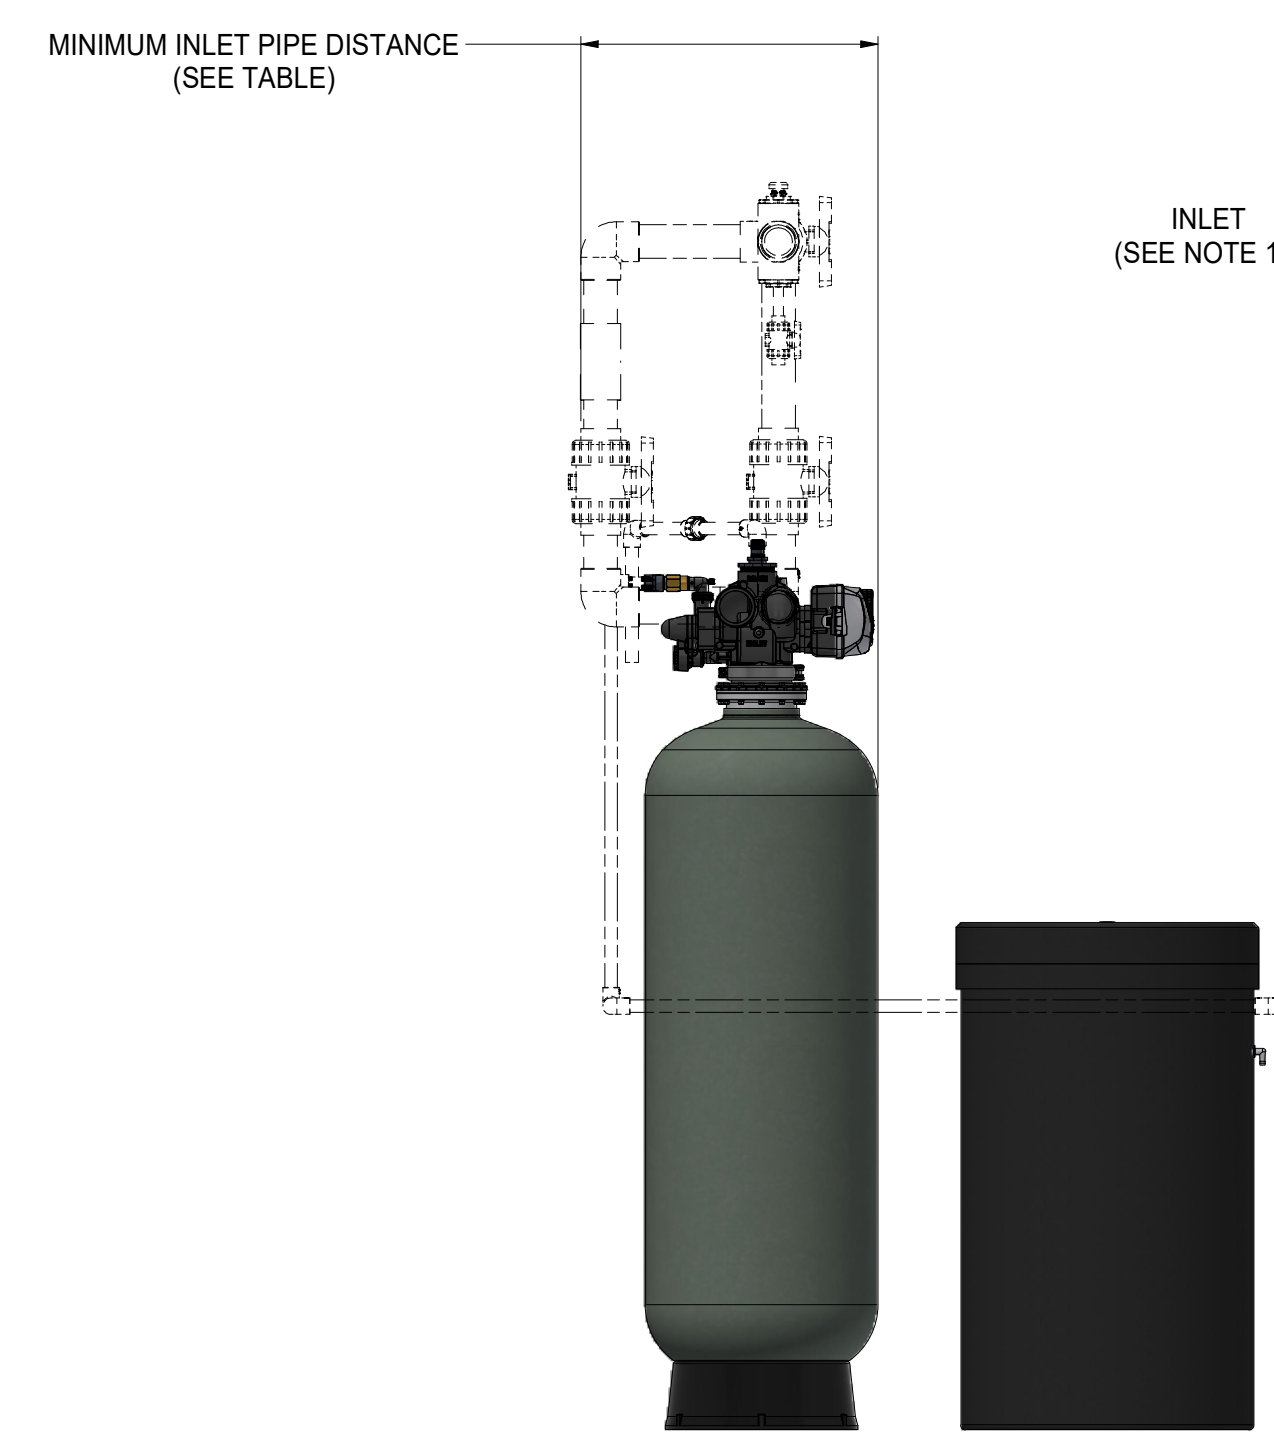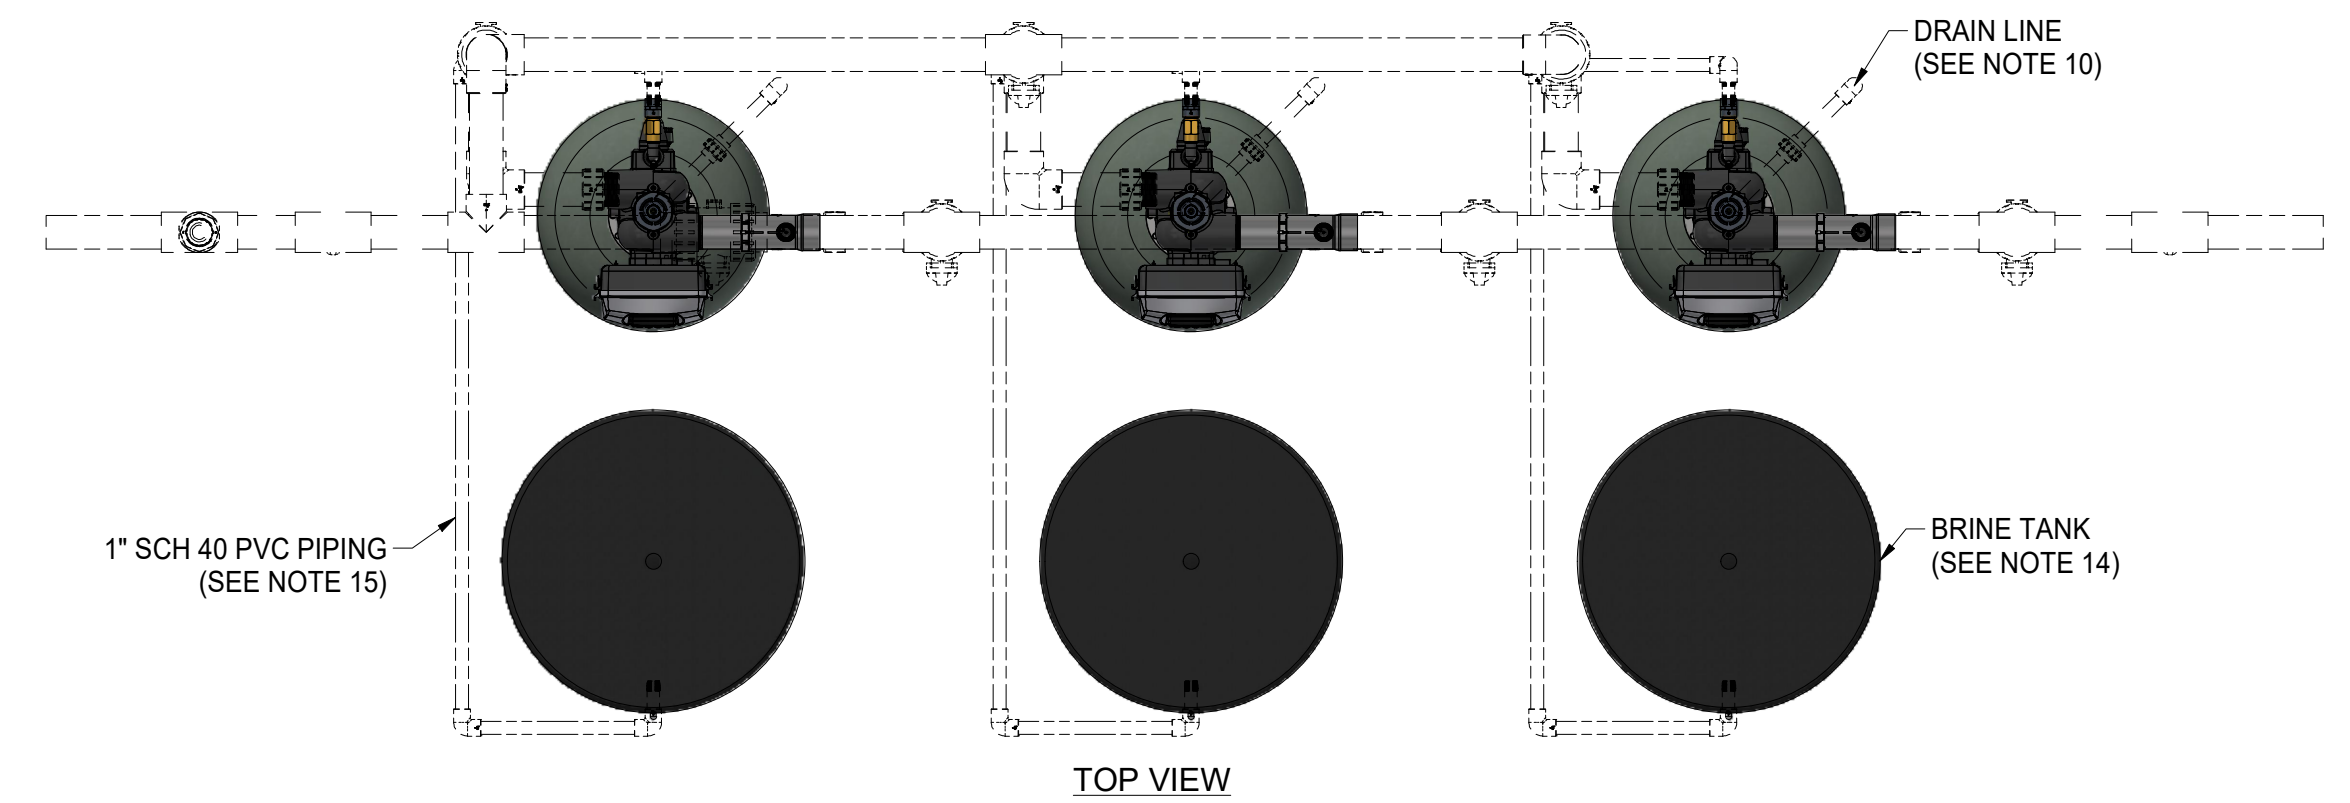

CLIENT PROJECT SIGN-OFF

JOB NAME: \_\_\_\_\_

JOB LOCATION: \_\_\_\_\_

CONTRACTOR: \_\_\_\_\_

CONTRACTOR APPROVAL: \_\_\_\_\_

CONTRACTOR APPROVAL DATE: \_\_\_\_\_

CONTRACTOR PO NO: \_\_\_\_\_

ENGINEER: \_\_\_\_\_

ENGINEER APPROVAL: \_\_\_\_\_

ENGINEER APPROVAL DATE: \_\_\_\_\_